



TYPICAL CABLE TRENCH DETAIL
(1:10)

SAND BEDDING: FOR ALL OPEN TRENCHING, A GEO-SYNTHETIC SHEETING SHALL BE LAID PRIOR TO INSTALLATION OF THE SAND BEDDING, THAT SHALL BE IN ACCORDANCE WITH EA TS 97-1 SPECIAL BACKFILLING MATERIAL FOR CABLE INSTALLATIONS

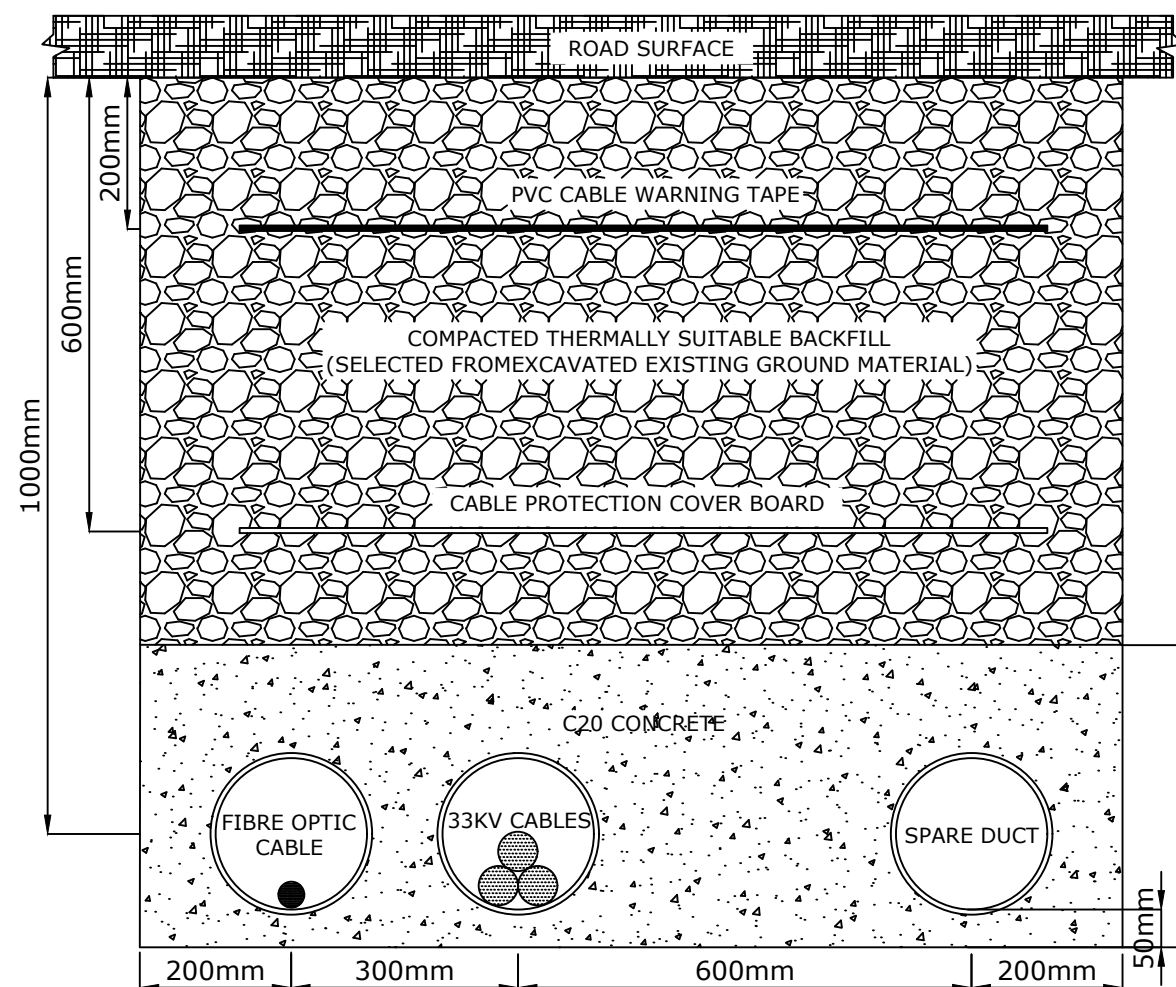

TYPICAL CABLE TRENCH DETAIL AT ROAD CROSSING
(1:10)



Legend:

Title: Figure 4.14
Typical Cable Trench Detail

Shepherds' Rig Wind Farm

Source: © Crown copyright and database rights
2018 Ordnance Survey 0100031673

Client: Infinergy

Drawn by: DB Checked: RF

Date: 03/10/18

Scale: 1:10 Revision: -