BORALEX

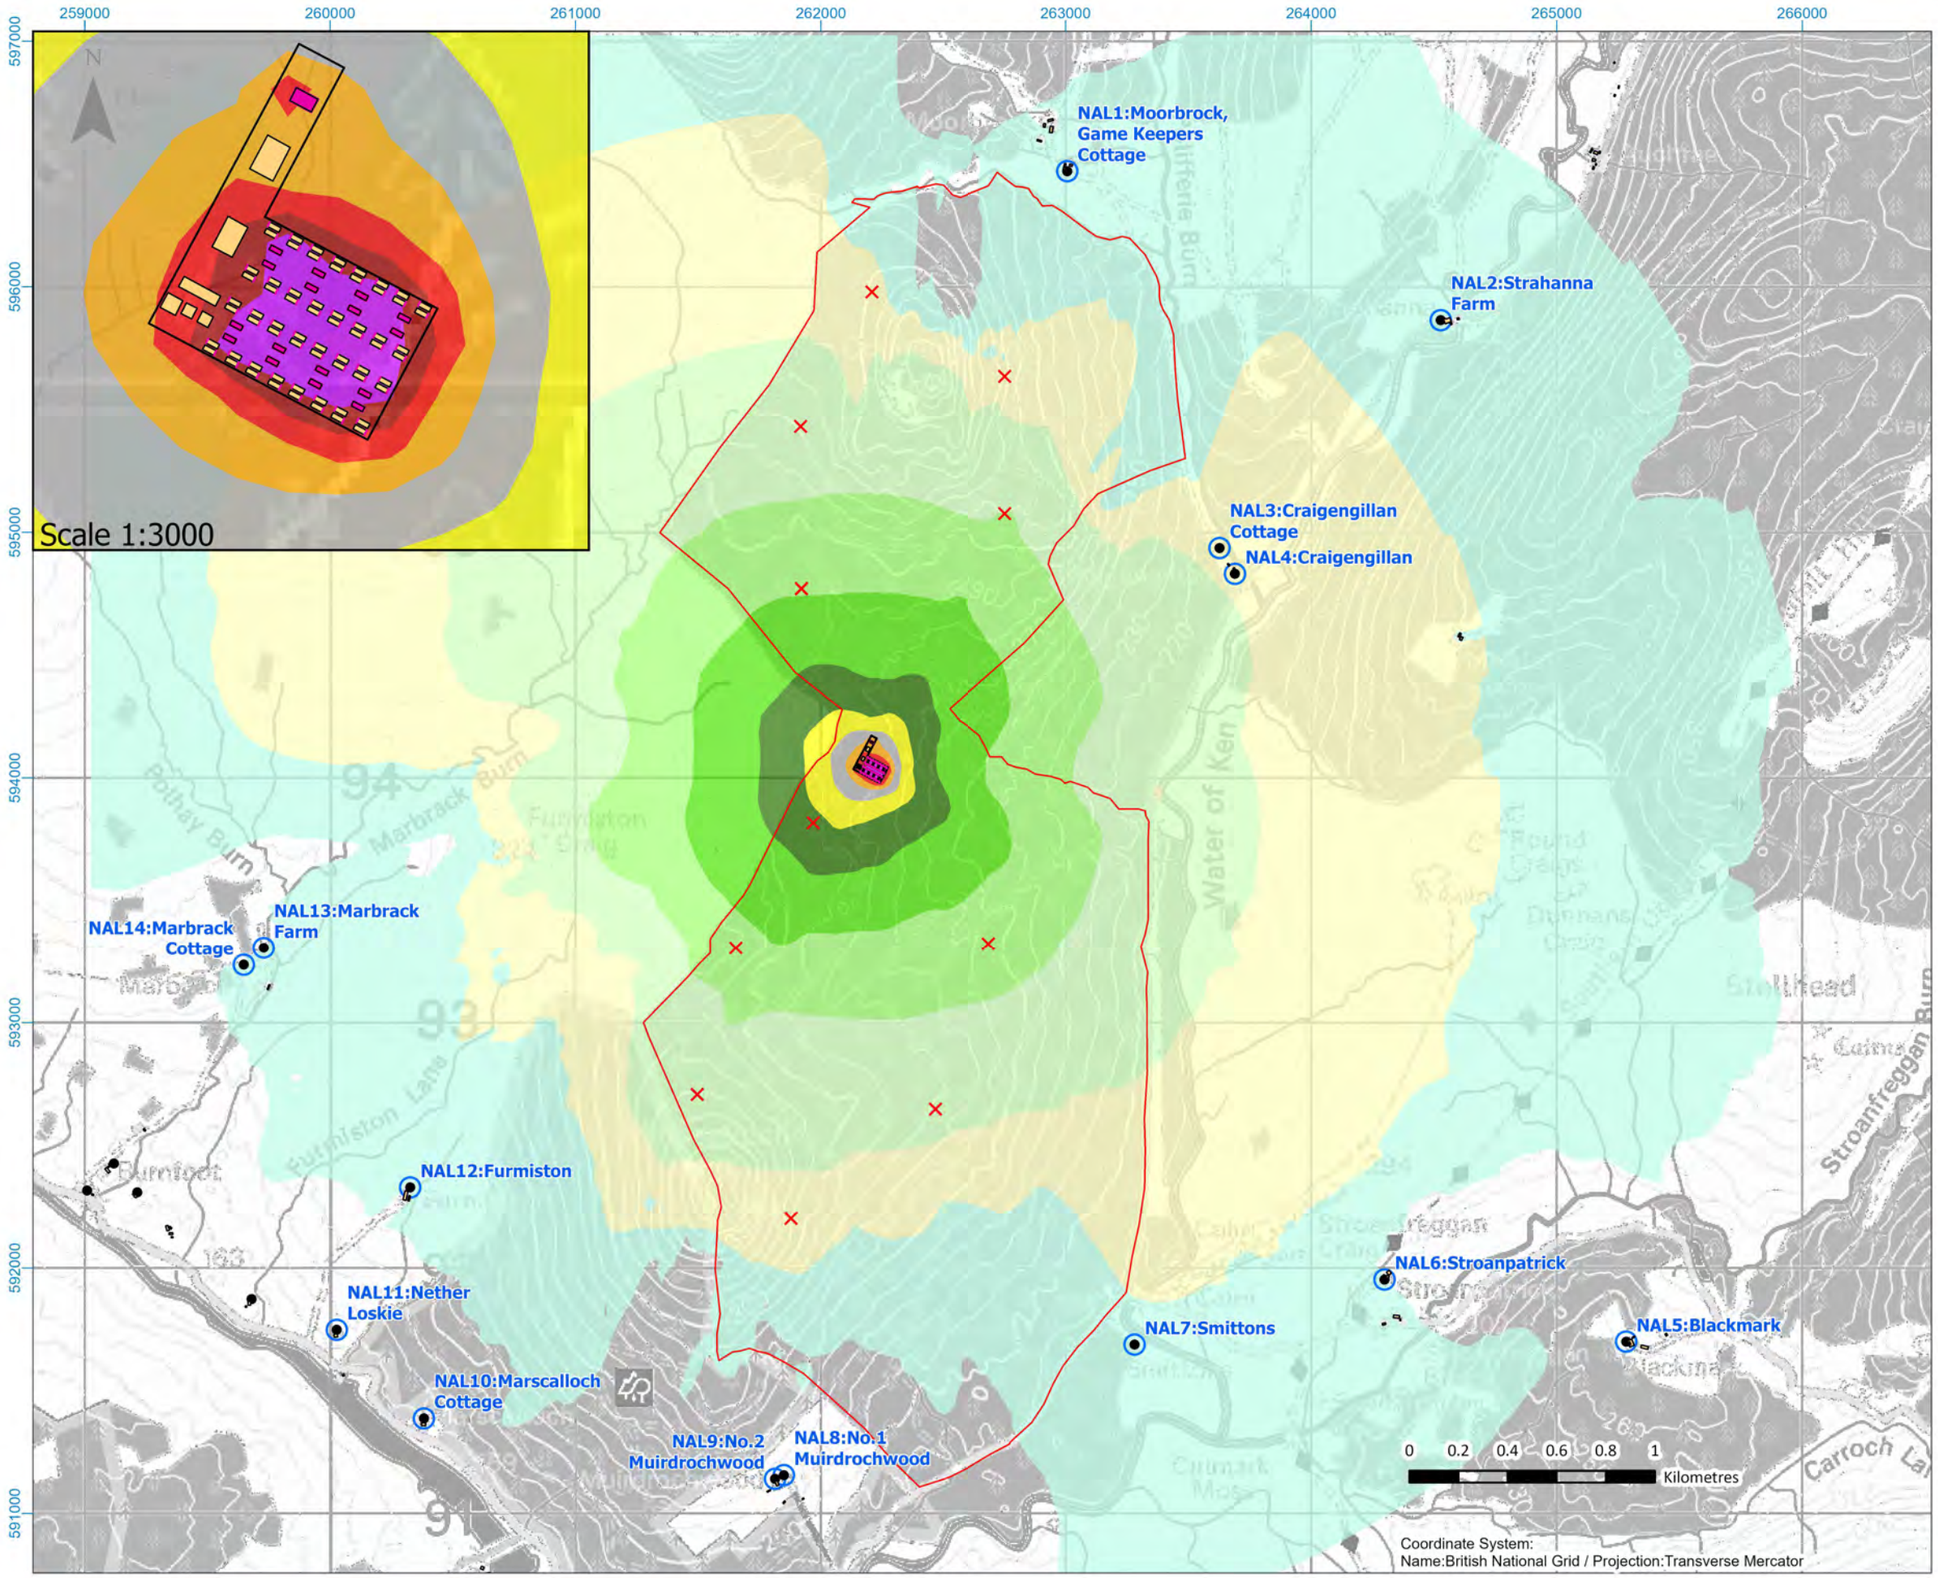

Legend:

- Site Boundary
- BESS and Substation Compound
- Noise Assessment Locations (NALs)
- Noise Sensitive Receptors (NSRs)
- Shepherds' Rig (Proposed Varied Development)
- Modelled Buildings
- Modelled Noise Sources

Predicted Noise Levels (dBA)

15 -20	30 -35	45 - 50	60 - 65
20 - 25	35 -40	50 - 55	65 - 70
25 -30	40 - 45	55 - 60	70 - 75

Noise contours have been modelled in accordance with ISO 9613 Part 2:2024 at a height of 4 m and displayed on a 25 m by 25 m grid. All noise sources are assumed to be operating concurrently. All levels are shown as dB LAeq(t)

Title

Figure 14.2
Noise Contour Plot

Project:

Shepherds' Rig Wind Farm Section 36C

Source:

Contains Ordnance Survey data, Crown copyright and database right 2026. Ordnance Survey 0100031673

Client: BORALEX

Drawn by:	Checked:
RE	GC
Date:	**Figure:**
06/07/2026	14.2
Scale:	**Revision No.**
1:25,000	01

SLR

tnei